


NOTES:

1. SERVICE PIPE TO BE WEAVED IN TRENCH TO ALLOW AT LEAST ONE (1) FOOT EXTRA LENGTH IN ITS LENGTH.
2. UPON COMPLETION OF WATER SERVICE CONSTRUCTION, ALL BOXES ARE TO BE SET AT FINISHED GRADE.
3. ALL SERVICES UNDER PAVEMENT TO BE AUGERED.
4. JET ALL TRENCHES.
5. ALL WATER SERVICES TO HOUSE WILL HAVE MINIMUM 5.5' OF GROUND COVER.
6. IEPA MINIMUM SEPARATION REQUIREMENTS MUST BE MAINTAINED BETWEEN SERVICES AND EXISTING SEWERS.
7. INSTALL CASING PIPE ON ALL SERVICES CROSSING COUNTY HIGHWAYS.
7. ABANDON EXISTING SERVICE AT CORPORATION USING COPPER DISC MUELLER H-15535 AND FLARE NUT.

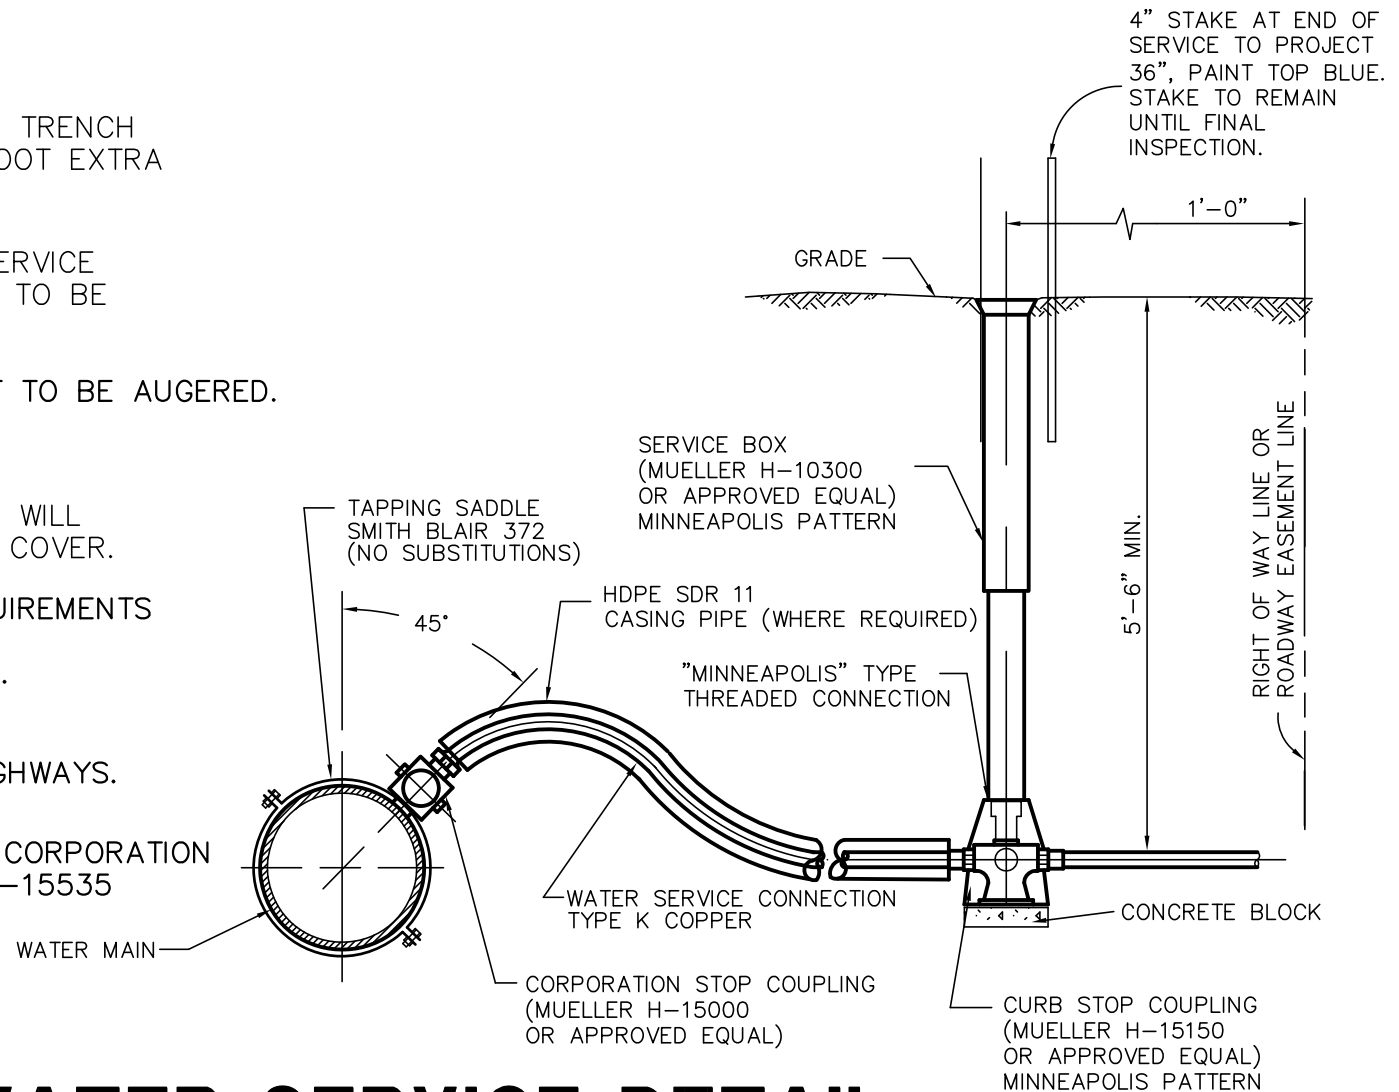

WATER SERVICE DETAIL